



NATIONAL TEST REPORT (BS 6180 : 2011)

# EASY GLASS<sup>®</sup> MAX FASCIA MOUNT MOD.6935





# **TEST REPORT**

| Lucideon Reference:   | 15469 (QT34585/1/SL)/Ref. 2/CR1   |
|-----------------------|---|
| Project Title:        | Testing of Q-Railing Europe Glass Balustrade System to BS 6180:2011 -<br>Easy Glass Max Fascia Side Mount |
| Client:               | Q-railing Europe GmbH & Co.KG<br>Marie-Curie-Strasse 8-14<br>Emmerich am Rhein<br>D-46446<br>Germany      |
| For the Attention of: | Mr Samuel Hanna   |
| Author(s):            | Mr Drew Bennett   |
|                       |   |
| Report Date:          | 10 March, 2015  |
| Purchase Order No.:   | 10-01510-00367  |
| Work Location:        | Lucideon UK   |

This report supersedes the report issued on 27.02.15.

pame foot

Miss Joanne Booth Consultancy Team Reviewer

Abent

Mr Drew Bennett Consultancy Team Project Manager

#### Page 1 of 12 Pages

This report is issued in accordance with the Conditions of Business of Lucideon Limited and relates only to the sample(s) tester. No responsibility is taken for the accuracy of the sampling unless this is done under our own supervision. This report shall not be reproduced in part without the written approval of Lucideon Limited, nor used in any way as to lead to misrepresentation of the results or their implications.

Lucideon Ltd
 Queens Road, Penkhull
 Stoke-on-Trent
 Staffordshire ST4 7LQ, UK

T +44 (0)1782 764428 enquiries@lucideon.com www.lucideon.com Reg. England 1960455

Lucideon is the trading name of Lucideon Limited. Registered in England No. 1960455. Registered Office as above.

Test Report: 15469/Ref. 2/CR1

#### CONTENTS

|    |                | Page |
|----|----------------|------|
| 1  | INTRODUCTION   | 3    |
| 2  | TEST SAMPLES   | 3    |
| 3  | TEST PROGRAMME | 3    |
| 4  | TEST METHOD    | 3    |
| 5  | RESULTS        | 4    |
| ТА | BLES           | 5-10 |
| PL | ATE            | 11   |
| CH | IART           | 12   |

### **APPENDIX – Q-Railing Figures**

DBe/LMP/N15TRE02 10.03.15 Lucideon were commissioned by the client, Q-Railing Europe GmbH and Co KG, to carry out load testing in accordance with BS 6180:2011 Barriers in and about buildings, to allow their balustrade system to be classified for use in accordance with the Code of Practice included within the standard.

The testing was carried out at Q-Railing Europe GmbH and Co KG's facilities at 8-14 Marie-Curie Stra $\beta$ e 46446 Emmerich am Rhein Germany.

This report summarizes the test results obtained during the test programme and does not provide interpretation of those results.

#### 2 TEST SAMPLES

The aluminium channel tested was designated as Easy Glass Max Fascia Side Mount (6935). The system is shown in Figure 1.

The channel was installed by Q-Railing Personnel.

#### 3 TEST PROGRAMME

A horizontal line load was applied to the aluminium channel with the following glass types:

- 19 mm glass size (w x h):1000 mm x 1000 mm (monolith glass heat toughened).
- 19 mm glass size (w x h):1000 mm x 1200 mm (monolith glass heat toughened).
- 25.52 mm glass size (w x h):1000 mm x 1200 mm (laminated PVB glass heat toughened).
- 31.52 mm glass size (w x h):1000 mm x 1200 mm (laminated PVB glass heat toughened).

#### 4 TEST METHOD

The channel was bolted to the top of a concrete block, which was fixed to the floor of the test facility. The 1.0 m length of channel was bolted to the block at 200 mm centres by the client using the appropriate fixings (see Figure 2).

A horizontal imposed line load was applied to the glass at a height of either 1.1 m or 1.0 m above the datum level of the floor and the deflection measured at the top central point of the panel 1.1 m above the datum level of the floor. The load was applied via a hydraulic ram and the deflection measured using a linear voltage displacement transducer (see Plate 1).

The test was carried out in accordance with the guidance given in BS 6180 Barriers in and about buildings – Code of Practice. The standard states that the maximum allowable deflection for a free standing glass protective barrier panel is 25 mm.

Table 2 of BS 6180 Barriers in and about buildings – Code of Practice categorises parapets, barriers and balustrades for areas of use depending on the loads they have achieved under testing.

The loads achieved by the Q-Railing Europe GmbH and Co KG glazing system tested under horizontal imposed line load to the maximum deflection of 25 mm are given in Table 1.

All figures quoted in Table 1 contain no safety factors and are direct loads as achieved by the system under test conditions.

Table 2 summarises the suitability of the tested systems in accordance with Table 2 of BS 6180:2011.

NOTE: The results given in this report apply only to the samples that have been tested.

END OF REPORT

| System                   | Glass                                       | Imposed Line<br>Load at 25 mm<br>Deflection<br>(kN/m) | Working<br>Line Load<br>for System<br>(kN/m) | Deflection at<br>Working Line<br>Load for<br>System (mm) |
|--------------------------|---|---|--|--|
|                          | 19 mm glass - size:<br>1000 mm x 1000 mm    | -   | 3.00   | 22.15  |
| Easy Glass<br>Max Fascia | 19 mm glass - size:<br>1000 mm x 1200 mm    | 2.46  | 1.50   | 13.01  |
| Side Mount               | 25.52 mm glass - size:<br>1000 mm x 1200 mm | -   | 3.00   | 23.07  |
|                          | 31.52 mm glass - size:<br>1000 mm x 1200 mm | 3.46  | 3.00   | 19.44  |

# Table 1 - Summary of Performance of Q-Railing Europe GmbH and Co. KG Balustrade System Tested under Horizontal Imposed Line Load

#### Table 2 - Summary of Suitability of Q-Railing Europe Systems in Accordance with Table 2 of BS 6180:2011

|  |   | Horizontal                                      | Easy Glass Max Fascia Side Mount         |  |   |   |
|--|---|---|--|--|---|---|
| Type of Occupancy<br>for Part of the<br>Building | Examples of<br>Specific Use   | Uniformly<br>Distributed<br>Line Load<br>(kN/m) | 19 mm Glass - Size:<br>1000 mm x 1000 mm | 19 mm Glass - Size:<br>1000 mm x 1200 mm | 25.52 mm Glass - Size:<br>1000 mm x 1200 mm | 31.52 mm Glass - Size:<br>1000 mm x 1200 mm |
|  | (i) all areas within<br>or serving<br>exclusively one<br>single family<br>dwelling including<br>stairs, landings,<br>etc but excluding<br>external<br>balconies and<br>edges of roofs | 0.36  | V  | V  | V   | ~   |
| Domestic and<br>residential activities           | (ii) other<br>residential, i.e.<br>houses of<br>multiple<br>occupancy and<br>balconies,<br>including Juliette<br>balconies and<br>edges of roofs in<br>single family<br>dwellings     | 0.74  | 1  | ~  | $\checkmark$                                | ~   |

|   | Examples of<br>Specific Use   | Horizontal<br>Uniformly<br>Distributed<br>Line Load<br>(kN/m) | Easy Glass Max Fascia Side Mount         |  |   |   |
|---|---|---|--|--|---|---|
| Type of Occupancy<br>for Part of the<br>Building                                |   |   | 19 mm Glass - Size:<br>1000 mm x 1000 mm | 19 mm Glass - Size:<br>1000 mm x 1200 mm | 25.52 mm Glass - Size:<br>1000 mm x 1200 mm | 31.52 mm Glass - Size:<br>1000 mm x 1200 mm |
| Offices and work<br>areas not included<br>elsewhere, including<br>storage areas | (iii) light access<br>stairs and<br>gangways not<br>more than<br>600 mm wide  | 0.22  | √  | √  | ✓   | ✓   |
|   | (iv) light<br>pedestrian traffic<br>routes in<br>industrial and<br>storage buildings<br>except<br>designated<br>escape routes   | 0.36  | ✓  | ✓  | ✓   | ✓   |
|   | (v) areas not<br>susceptible to<br>overcrowding in<br>office and<br>institutional<br>buildings, also<br>industrial and<br>storage buildings<br>except as given<br>above | 0.74  | ✓  | ✓  | ✓   | ✓   |

|   | Examples of<br>Specific Use  | Horizontal<br>Uniformly<br>Distributed<br>Line Load<br>(kN/m) | Easy Glass Max Fascia Side Mount         |  |   |   |
|---|--|---|--|--|---|---|
| Type of Occupancy<br>for Part of the<br>Building  |  |   | 19 mm Glass - Size:<br>1000 mm x 1000 mm | 19 mm Glass - Size:<br>1000 mm x 1200 mm | 25.52 mm Glass - Size:<br>1000 mm x 1200 mm | 31.52 mm Glass - Size:<br>1000 mm x 1200 mm |
| Areas where people might congregate   | (vi) areas having<br>fixed seating<br>within 530 mm of<br>the barrier,<br>balustrade or<br>parapet   | 1.50  | ~  | ✓  | ✓   | ✓   |
| Areas with tables or<br>fixed seating   | (vii) restaurants and bars   | 1.50  | ~  | $\checkmark$                             | $\checkmark$                                | ✓   |
|   | (viii) stairs,<br>landings<br>corridors ramps  | 0.74  | $\checkmark$                             | ✓  | ✓   | $\checkmark$                                |
| Areas without<br>obstacles for moving<br>people and not<br>susceptible to<br>overcrowding | (ix) external<br>balconies<br>including Juliette<br>balconies and<br>edges of roofs;<br>footways and<br>pavements within<br>building cartilage<br>adjacent to<br>basement/sunke<br>n areas | 0.74  | ~  | V  | V   | ~   |

|  | Examples of<br>Specific Use  | Horizontal<br>Uniformly<br>Distributed<br>Line Load<br>(kN/m) | Easy Glass Max Fascia Side Mount         |  |   |   |
|--|--|---|--|--|---|---|
| Type of Occupancy<br>for Part of the<br>Building |  |   | 19 mm Glass - Size:<br>1000 mm x 1000 mm | 19 mm Glass - Size:<br>1000 mm x 1200 mm | 25.52 mm Glass - Size:<br>1000 mm x 1200 mm | 31.52 mm Glass - Size:<br>1000 mm x 1200 mm |
|  | (x) footways or<br>pavements less<br>than 3 m wide<br>adjacent to<br>sunken areas  | 1.50  | $\checkmark$                             | ~  | ~   | ~   |
| Areas susceptible to overcrowding                | (xi) theatres,<br>cinemas,<br>discotheques,<br>bars, auditoria,<br>shopping malls,<br>assembly areas,<br>studios; footways<br>or pavements<br>greater than 3 m<br>wide adjacent to<br>sunken areas | 3.00  | ✓  | x  | ✓   | ✓   |
|  | (xii) grandstands and stadia   | (Note 1)  | -  | -  | -   | -   |
| Retail areas                                     | (xiii) all retail<br>areas including<br>public areas of<br>banks/building<br>societies or<br>betting shops   | 1.50  | $\checkmark$                             | ✓  | ✓   | ✓   |

|  |   | Horizontal                                      | Easy Glass Max Fascia Side Mount         |  |   |   |
|--|---|---|--|--|---|---|
| Type of Occupancy<br>for Part of the<br>Building | Examples of<br>Specific Use   | Uniformly<br>Distributed<br>Line Load<br>(kN/m) | 19 mm Glass - Size:<br>1000 mm x 1000 mm | 19 mm Glass - Size:<br>1000 mm x 1200 mm | 25.52 mm Glass - Size:<br>1000 mm x 1200 mm | 31.52 mm Glass - Size:<br>1000 mm x 1200 mm |
| Vehicular  | (xiv) pedestrian<br>areas in car<br>parks, including<br>stairs, landings,<br>ramps, edges of<br>internal floors,<br>footways, edges<br>of roofs | 1.50 (Note 2)                                   | ~  | ✓  | ✓   | ✓   |
|  | (xv) horizontal<br>loads imposed by<br>vehicles   | (Note 2)  | -  | -  | -   | -   |

Note 1 – See requirements of the appropriate certifying authority Note 2 – Clause 8.1.1 of BS 6180:2011 states that "glass should not be used for vehicle protection barriers"



Plate 1 - Generic Test Arrangement



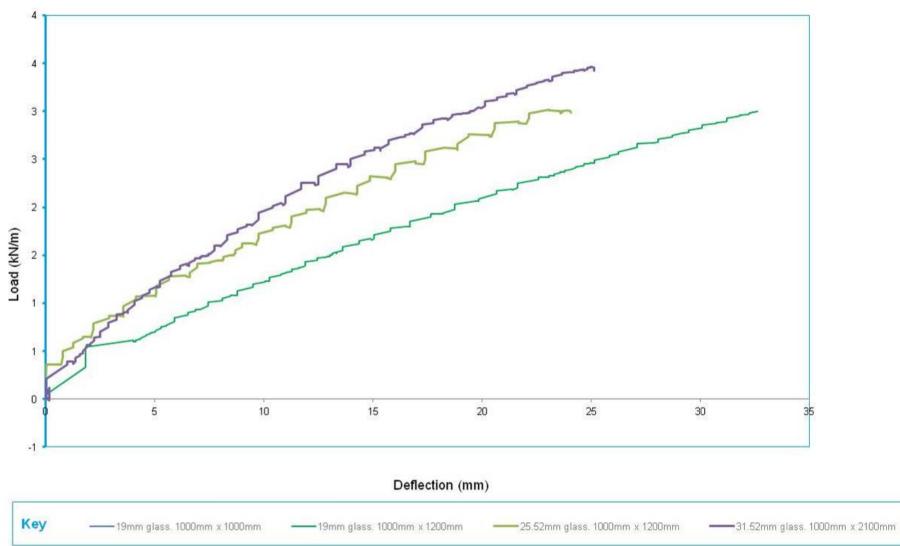


Chart 1 - Load-Deflection Curve for Q-Railing Easy Glass Max Fascia Side Mount

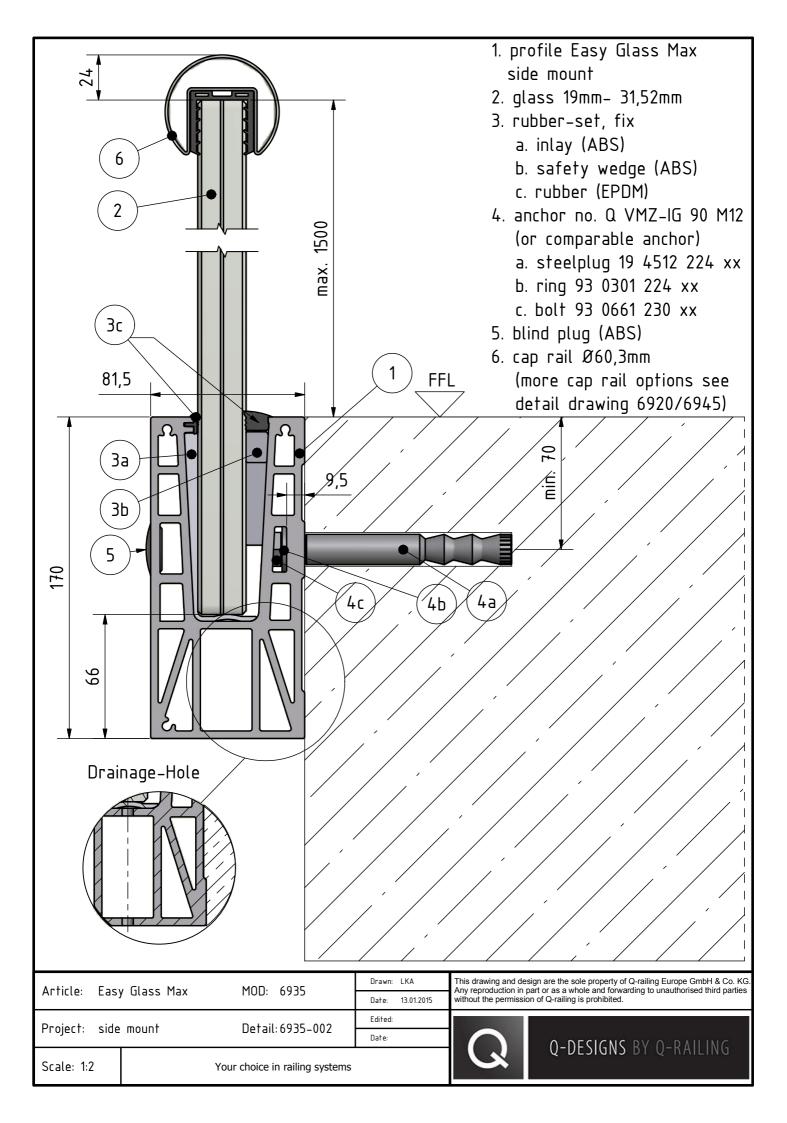

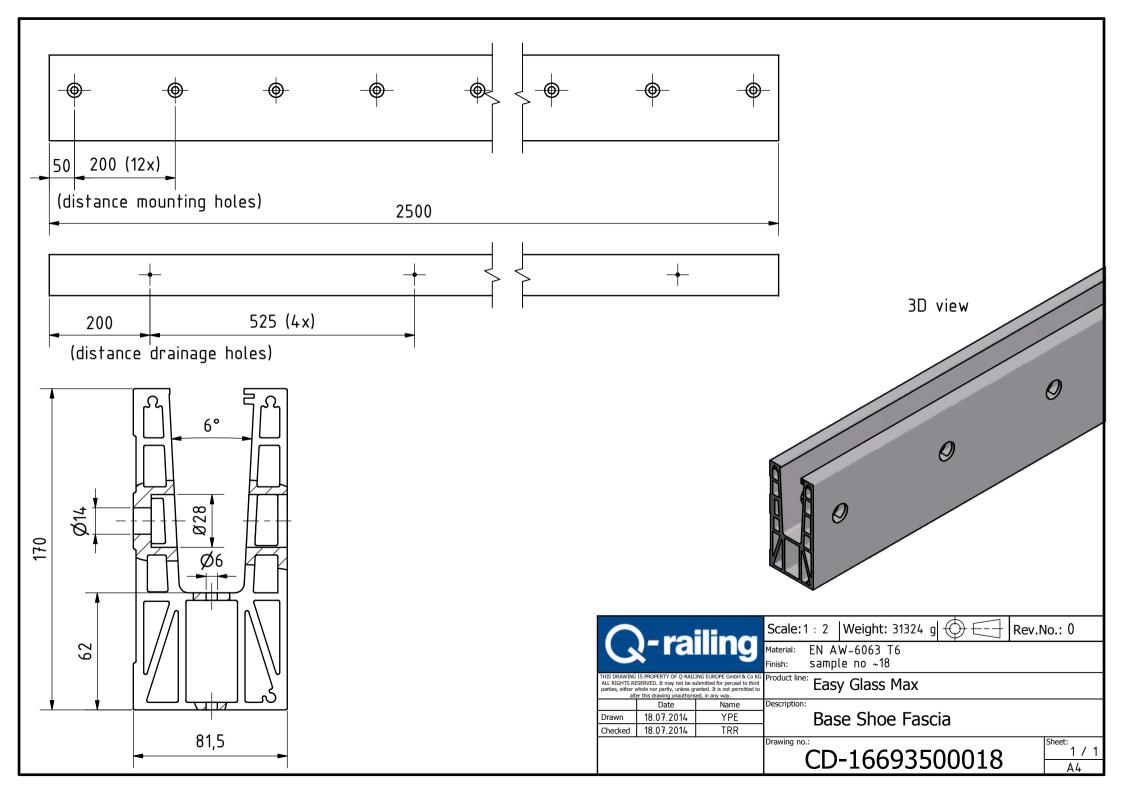

## GOOD LUCK WITH YOUR INSTALLATION!

VIEL ERFOLG MIT IHRER MONTAGE!

SUCCES MET DE INSTALLATIE!

Q-railing