YOUR CHOICE IN RAILING SYSTEMS 🛛 🖪 🗹 You Tube



NATIONAL TEST REPORT (BS 6180 : 2011)

# **EASY GLASS<sup>®</sup> PRO** F-PROFILE MOD.6909

FIXED "SAFETY WEDGES SYSTEM", H= 1100MM FIXED "SAFETY WEDGES SYSTEM", H= 1200MM

ADJUSTABLE "SAFETY WEDGES SYSTEM", H= 1100MM ADJUSTABLE "SAFETY WEDGES SYSTEM", H= 1200MM





### **TEST REPORT**

Lucideon Reference:	143646 (QT-31643/1/SL)/Ref. 3/CR1
Project Title:	Testinfg of Q-railing Europe Glass Balustrade System to BS 6180:2011 - Easy Glass Pro-F Top Mount Fixed
Client:	Q-railing Europe GmbH & Co.KG Marie-Curie-Strasse 8-14 Emmerich am Rhein D-46446 Germany
For the Attention of:	Mr Samuel Hanna
Author(s):	Miss Lisa Cobden
Report Date:	
Report Date:	11 November, 2014
Purchase Order No.:	N/A
Work Location:	Lucideon UK

This report supersedes the report issued on 29.08.14.

Mr Dave Dix Consultancy Team Reviewer

bu Con-

Miss Lisa Cobden Consultancy Team Project Manager

#### Page 1 of 8 Pages

This report is issued in accordance with the Conditions of Business of Lucideon Limited and relates only to the sample(s) tester. No responsibility is taken for the accuracy of the sampling unless this is done under our own supervision. This report shall not be reproduced in part without the written approval of Lucideon Limited, nor used in any way as to lead to misrepresentation of the results or their implications.

Lucideon Ltd
 Queens Road, Penkhull
 Stoke-on-Trent
 Staffordshire ST4 7LQ, UK

T +44 (0)1782 764428 enquiries@lucideon.com www.lucideon.com Reg. England 1960455

Lucideon is the trading name of Lucideon Limited. Registered in England No. 1960455. Registered Office as above.

Test Report: 143646/Ref. 3/CR1

#### CONTENTS

	Page
1 INTRODUCTION	3
2 TEST SAMPLES	3
3 TEST PROGRAMME	3
4 TEST METHOD	3
5 RESULTS	4
TABLES	5-6
PLATE	7
CHART	8
APPENDIX: Figures	

LSC/LMP/N14TRE48 11.11.14



#### **1 INTRODUCTION**

Lucideon were commissioned by the client, Q-railing Europe GmbH and Co KG, to carry out load testing in accordance with BS 6180:2011 Barriers in and about buildings, to allow their balustrade system to be classified for use in accordance with the Code of Practice included within the standard.

The testing was carried out at Q-railing Europe GmbH and Co KG's facilities at 8-14 Marie-Curie Straße 46446 Emmerich am Rhein Germany.

This report summarises the test results obtained during the test programme and does not provide interpretation of those results.

#### 2 TEST SAMPLES

The aluminium channel tested was designated as Easy Glass Pro-F Top Mount Fixed. The system is shown in Figure 1.

The channel was installed by Q-railing personnel.

#### **3 TEST PROGRAMME**

A horizontal line load was applied to the aluminium channel with the following glass types installed:

- Laminated VSG Glass 16.76 mm size (w x h):1000 mm x 1100 mm.
- Laminated VSG Glass 21.52 mm size (w x h):1000 mm x 1100 mm.
- Laminated Sentry Glass 21.52 mm size (w x h): 1000 mm x 1100 mm.
- Monolithic ESG Glass 19 mm size (w x h): 1000 mm x 1100 mm.
- Monolithic ESG Glass 15 mm size (w x h): 1000 mm x 1100 mm.

#### 4 TEST METHOD

The channel was bolted to the top of a concrete block, which was fixed to the floor of the test facility. The 1.0 m length of channel was bolted to the block at 200 mm centres by the client using the appropriate fixings.

The appropriate thickness glass panel was fitted into the channel using the 'Safety Wedge' fixing clips at four clips per metre such that the plastic clip was to the inside face of the glass (see Figures 2 and 3).

A horizontal imposed line load was applied to the glass at a height of 1.1 m above the datum level of the floor and the deflection measured at the top central point of the panel 1.1 m above the datum level of the floor. The load was applied via a hydraulic ram and the deflection measured using a linear voltage displacement transducer (see Plate 1).



#### 5 RESULTS

The test was carried out in accordance with the guidance given in BS 6180 Barriers in and about buildings – Code of Practice. The standard states that the maximum allowable deflection for a free standing glass protective barrier panel is 25 mm.

Table 2 of BS 6180 Barriers in and about buildings – Code of Practice categorises parapets, barriers and balustrades for areas of use depending on the loads they have achieved under testing.

The loads achieved by the Q-railing Europe GmbH and Co KG glazing system tested under horizontal imposed line load to the maximum deflection of 25 mm are given in Table 1.

All figures quoted in Table 1 contain no safety factors and are direct loads as achieved by the system under test conditions.

Table 2 summarises the suitability of the tested systems in accordance with Table 2 of BS 6180:2011.

NOTE: The results given in this report apply only to the samples that have been tested.

#### END OF REPORT



Table 1:	Summary of Performance of Q-railing Europe GmbH and Co. KG Balustrade System
	Tested under Horizontal Imposed Line Load

Base Rail	Glass	Imposed Line Load at 25 mm Deflection (kN/m)	Working Line Load for System (kN/m)	Deflection at Working Line Load for System (mm)
	Laminated VSG Glass 16.76 mm	0.74	0.74	25.00
	Laminated VSG Glass 21.52 mm	1.05	0.74	16.28
System	Laminated Sentry Glass 21.52 mm	1.62	1.50	21.92
	Monolithic ESG 19 mm	1.60	1.50	22.97
	Monolithic ESG 15 mm	1.14	0.74	15.47

Type of		Horizontal	Easy Glass Pro-F Top Mount Fixed				
Occupancy for Part of the Building	Examples of Specific Use	Uniformly Distributed Line Load (kN/m)	16.76 mm	21.52 mm	Sentry 21.52 mm	19 mm	15 mm
Domestic and	(i) all areas within or serving exclusively one single family dwelling including stairs, landings, etc but excluding external balconies and edges of roofs	0.36	V	¥	V	V	✓
residential activities	(ii) other residential, i.e. houses of multiple occupancy and balconies, including Juliette balconies and edges of roofs in single family dwellings	0.74	V	V	V	V	✓
	(iii) light access stairs and gangways not more than 600 mm wide	0.22	~	~	~	~	~
Offices and work areas not included elsewhere, including storage areas	(iv) light pedestrian traffic routes in industrial and storage buildings except designated escape routes	0.36	~	V	V	~	~
	(v) areas not susceptible to overcrowding in office and institutional buildings, also industrial and storage buildings except as given above	0.74	~	~	~	~	~

 
 Table 2:
 Summary of Suitability of Q-railing Europe Systems in Accordance with Table 2 of BS 6180:2011

Test Report: 143646/Ref. 3/CR1

Type of		Horizontal		Easy Glass Pro-F Top Mount Fixed			
Occupancy for Part of the Building		Uniformly Distributed Line Load (kN/m)	16.76 mm	21.52 mm	Sentry 21.52 mm	19 mm	15 mm
Areas where people might congregate	(vi) areas having fixed seating within 530 mm of the barrier, balustrade or parapet	1.50	х	х	V	~	х
Areas with tables or fixed seating	(vii) restaurants and bars	1.50	х	х	~	~	х
Areas without	(viii) stairs, landings corridors ramps	0.74	~	~	~	~	✓
obstacles for moving people and not susceptible to overcrowding	(ix) external balconies including Juliette balconies and edges of roofs; footways and pavements within building cartilage adjacent to basement/sunken areas	0.74	~	~	~	~	~
	(x) footways or pavements less than 3 m wide adjacent to sunken areas	1.50	х	х	~	~	х
Areas susceptible to overcrowding	(xi) theatres, cinemas, discotheques, bars, auditoria, shopping malls, assembly areas, studios; footways or pavements greater than 3 m wide adjacent to sunken areas	3.00	Х	Х	Х	х	х
	(xii) grandstands and stadia	(Note 1)	-	-	-	-	-
Retail areas	(xiii) all retail areas including public areas of banks/building societies or betting shops	1.50	х	х	✓	~	х
Vehicular	(xiv) pedestrian areas in car parks, including stairs, landings, ramps, edges of internal floors, footways, edges of roofs	1.50 (Note 2)	х	х	~	~	х
	(xv) horizontal loads imposed by vehicles	(Note 2)	-	-	-	-	-

Note 1 – See requirements of the appropriate certifying authority Note 2 – Clause 8.1.1 of BS 6180:2011 states that "glass should not be used for vehicle protection barriers"

Test Report: 143646/Ref. 3/CR1



Plate 1: Generic Test Arrangement



Test Report: 143646/Ref. 3/CR1





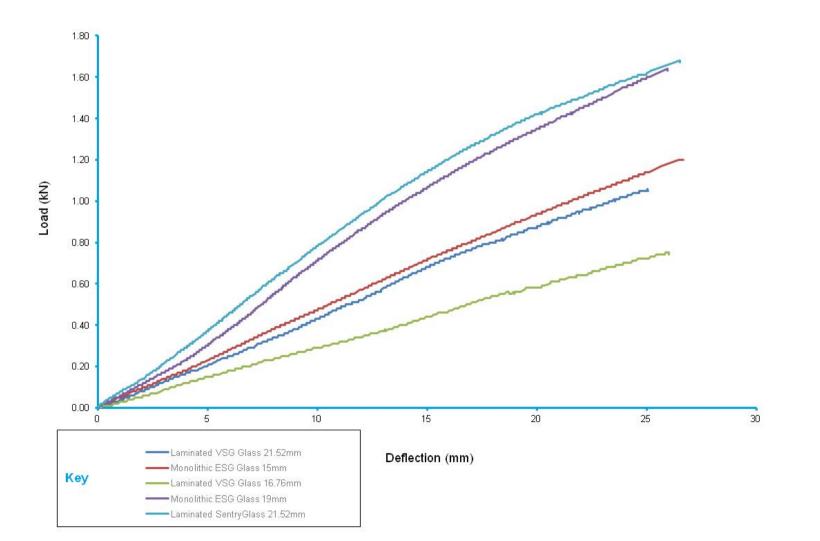


Chart 1: Load Versus Deflection Curves for Q-railing Easy Glass Pro-F Top Mount Fixed

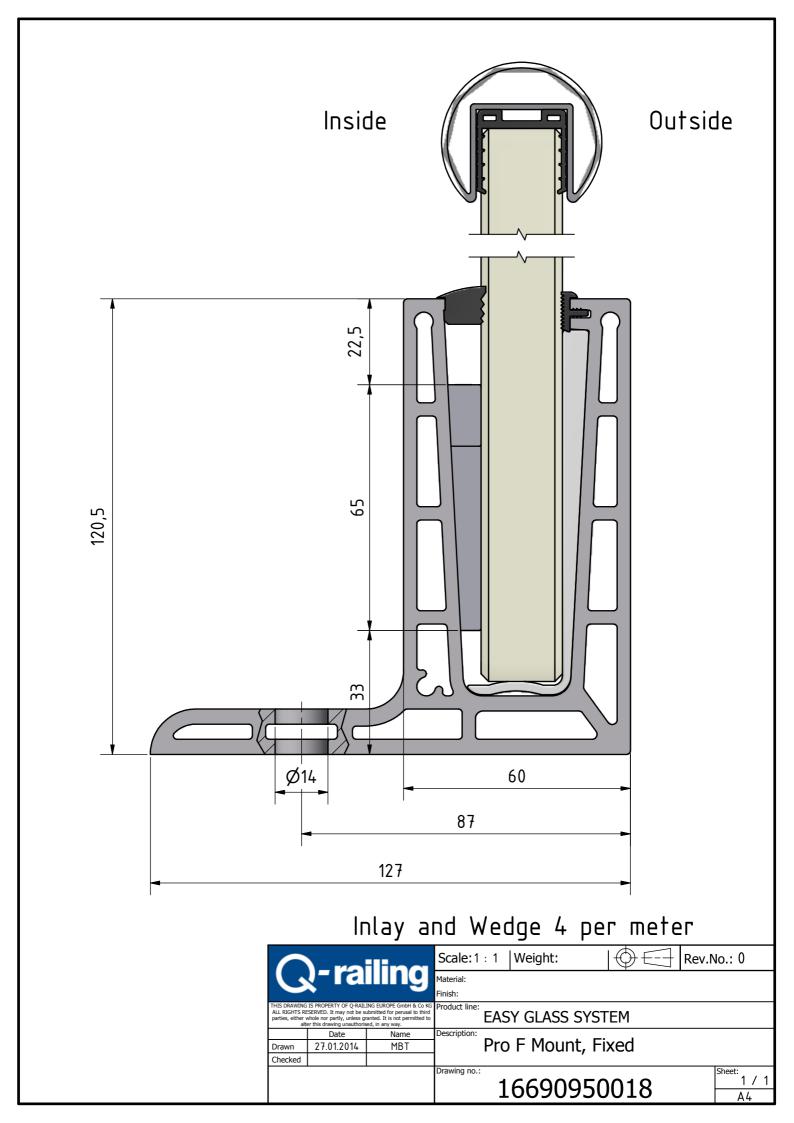

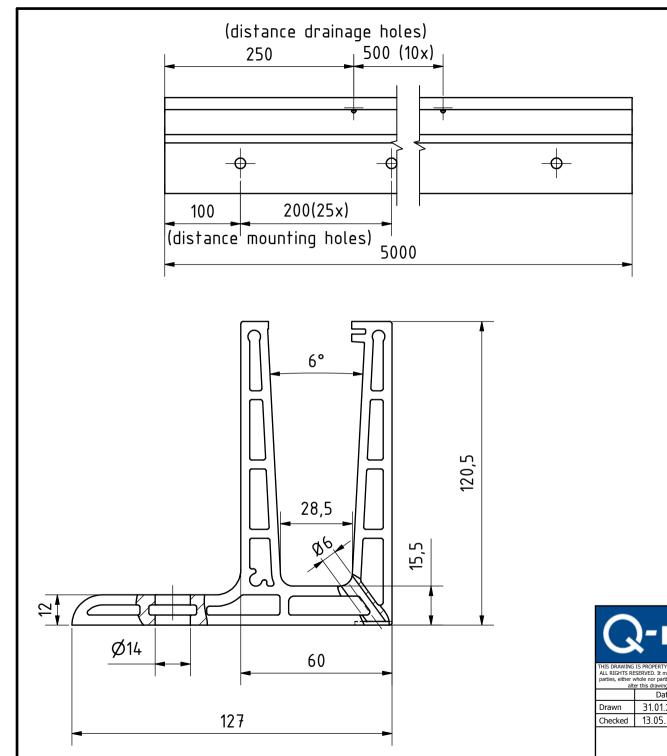

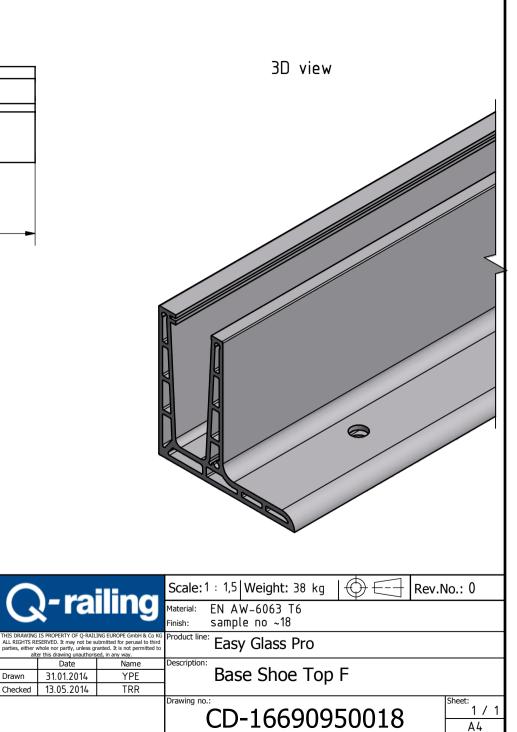

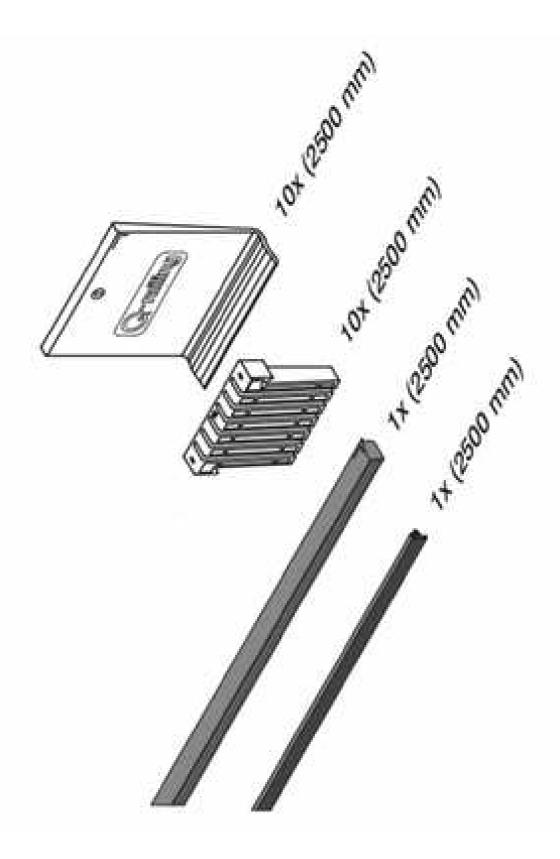



### **TEST REPORT**

Lucideon Reference:	143646 (QT-31643/1/SL)/Ref. 4/CR1
Project Title:	Testing of Q-railing Europe Glass Balustrade System to BS 6180:2011 - Easy Glass Pro-F Top Mount Fixed at Horizontal Line Load 1200 mm
Client:	Q-railing Europe GmbH & Co.KG Marie-Curie-Strasse 8-14 Emmerich am Rhein D-46446 Germany
For the Attention of:	Mr Samuel Hanna
Author(s):	Miss Lisa Cobden
Report Date:	11 November, 2014
Purchase Order No.:	N/A
Work Location:	Lucideon UK

This report supersedes the report issued on 29.08.14.

Mr Dave Dix Consultancy Team Reviewer

bu Con-

Miss Lisa Cobden Consultancy Team Project Manager

#### Page 1 of 8 Pages

This report is issued in accordance with the Conditions of Business of Lucideon Limited and relates only to the sample(s) tester. No responsibility is taken for the accuracy of the sampling unless this is done under our own supervision. This report shall not be reproduced in part without the written approval of Lucideon Limited, nor used in any way as to lead to misrepresentation of the results or their implications.

Lucideon Ltd Queens Road, Penkhull Stoke-on-Trent Staffordshire ST4 7LQ, UK T +44 (0)1782 764428 enquiries@lucideon.com www.lucideon.com Reg. England 1960455

Lucideon is the trading name of Lucideon Limited. Registered in England No. 1960455. Registered Office as above.

Test Report: 143646/Ref. 4/CR1

#### CONTENTS

F	Page
1 INTRODUCTION 3	3
2 TEST SAMPLES	3
3 TEST PROGRAMME	3
4 TEST METHOD	3
5 RESULTS	4
TABLES 5-	-6
PLATE	7
CHART	8
APPENDIX: Figures	

LSC/LMP/N14TRE49 11.11.14



#### **1 INTRODUCTION**

Lucideon were commissioned by the client, Q-railing Europe GmbH and Co KG, to carry out load testing based on that detailed in BS 6180:2011 Barriers in and about buildings. This was to allow their balustrade system to be classified for use in accordance with the Code of Practice included within the standard. The test method deviated from the standard such that the horizontal imposed line load was applied to the glass at a height of 1.2 m above the datum level of the floor in comparison to 1.1 m stated in the standard. Deflection of the glass panel was measured at the top central point and was also recorded at 1.2 m above the datum level of the floor.

The testing was carried out at Q-railing Europe GmbH and Co KG's facilities at 8-14 Marie-Curie Straße 46446 Emmerich am Rhein Germany.

This report summarises the test results obtained during the test programme and does not provide interpretation of those results.

#### 2 TEST SAMPLES

The aluminium channel tested was designated as Easy Glass Pro-F Top Mount Fixed. The system is shown in Figure 1.

The channel was installed by Q-railing personnel.

#### **3 TEST PROGRAMME**

A horizontal line load was applied to the aluminium channel with the following glass types installed:

- Laminated VSG Glass 21.52 mm size (w x h):1000 mm x 1200 mm.
- Laminated Sentry Glass 21.52 mm size (w x h): 1000 mm x 1300 mm.
- Monolithic ESG Glass 19 mm size (w x h): 1000 mm x 1200 mm.
- Monolithic ESG Glass 15 mm size (w x h): 1000 mm x 1200 mm.

#### 4 TEST METHOD

The channel was bolted to the top of a concrete block, which was fixed to the floor of the test facility. The 1.0 m length of channel was bolted to the block at 200 mm centres by the client using the appropriate fixings.

The appropriate thickness glass panel was fitted into the channel using the 'Safety Wedge' fixing clips at four clips per metre such that the plastic clip was to the inside face of the glass (see Figures 2 and 3).



A horizontal imposed line load was applied to the glass at a height of 1.2 m above the datum level of the floor and the deflection measured at the top central point of the panel 1.2 m above the datum level of the floor. The load was applied via a hydraulic ram and the deflection measured using a linear voltage displacement transducer (see Plate 1).

#### 5 RESULTS

The test was carried out in accordance with the guidance given in BS 6180 Barriers in and about buildings – Code of Practice. The standard states that the maximum allowable deflection for a free standing glass protective barrier panel is 25 mm.

Table 2 of BS 6180 Barriers in and about buildings – Code of Practice categorises parapets, barriers and balustrades for areas of use depending on the loads they have achieved under testing.

The loads achieved by the Q-railing Europe GmbH and Co KG glazing system tested under horizontal imposed line load to the maximum deflection of 25 mm are given in Table 1.

All figures quoted in Table 1 contain no safety factors and are direct loads as achieved by the system under test conditions.

Table 2 summarises the suitability of the tested systems in accordance with Table 2 of BS 6180:2011.

NOTE: The results given in this report apply only to the samples that have been tested.

#### **END OF REPORT**



Test Report: 143646/Ref. 4/CR1

Table 1:	Summary of Performance of Q-railing Europe GmbH and Co KG Balustrade System Tested
	under Horizontal Imposed Line Load

Base Rail	Base Rail Glass		Working Line Load for System (kN/m)	Deflection at Working Line Load for System (mm)	
System	Laminated VSG Glass 21.52 mm	0.94	0.74	19.74	
	Laminated Sentry Glass 21.52 mm	1.62	1.50	21.92	
	Monolithic ESG 19 mm	1.40	0.74	11.60	
	Monolithic ESG 15 mm	1.03	0.74	17.97	

Table 2:	Summary of Suitability of Q-railing Europe Systems in Accordance with Table 2 of
	BS 6180:2011

Type of		Horizontal	Easy Glass Pro-F Top Mount Fixed			
Occupancy for Part of the Building	Examples of Specific Use	Uniformly Distributed Line Load (kN/m)	21.52 mm	Sentry 21.52 mm	19 mm	15 mm
Domestic and residential activities	(i) all areas within or serving exclusively one single family dwelling including stairs, landings, etc but excluding external balconies and edges of roofs	0.36	~	~	~	✓
	(ii) other residential, i.e. houses of multiple occupancy and balconies, including Juliette balconies and edges of roofs in single family dwellings	0.74	~	~	~	✓
Offices and work areas not included elsewhere, including storage areas	(iii) light access stairs and gangways not more than 600 mm wide	0.22	~	~	~	~
	(iv) light pedestrian traffic routes in industrial and storage buildings except designated escape routes	0.36	V	V	√	~
	(v) areas not susceptible to overcrowding in office and institutional buildings, also industrial and storage buildings except as given above	0.74	V	V	V	✓
Areas where people might congregate	(vi) areas having fixed seating within 530 mm of the barrier, balustrade or parapet	1.50	х	~	х	х

Test Report: 143646/Ref. 4/CR1

Type of	Type of		Easy Glass Pro-F Top Mount Fixed			
Occupancy for Part of the Building	Examples of Specific Use	Uniformly Distributed Line Load (kN/m)	21.52 mm	Sentry 21.52 mm	19 mm	15 mm
Areas with tables or fixed seating	(vii) restaurants and bars	1.50	х	~	х	х
Areas without	(viii) stairs, landings corridors ramps	0.74	~	~	~	~
obstacles for moving people and not susceptible to overcrowding	(ix) external balconies including Juliette balconies and edges of roofs; footways and pavements within building cartilage adjacent to basement/sunken areas	0.74	~	~	~	~
	(x) footways or pavements less than 3 m wide adjacent to sunken areas	1.50	х	~	х	х
Areas susceptible to overcrowding	(xi) theatres, cinemas, discotheques, bars, auditoria, shopping malls, assembly areas, studios; footways or pavements greater than 3 m wide adjacent to sunken areas	3.00	х	x	x	x
	(xii) grandstands and stadia	(Note 1)	-	-	-	-
Retail areas	(xiii) all retail areas including public areas of banks/building societies or betting shops	1.50	х	~	х	х
Vehicular	(xiv) pedestrian areas in car parks, including stairs, landings, ramps, edges of internal floors, footways, edges of roofs	1.50 (Note 2)	Х	1	x	x
	(xv) horizontal loads imposed by vehicles	(Note 2)	-	-	-	-

Note 1 – See requirements of the appropriate certifying authority Note 2 – Clause 8.1.1 of BS 6180:2011 states that "glass should not be used for vehicle protection barriers"

Test Report: 143646/Ref. 4/CR1

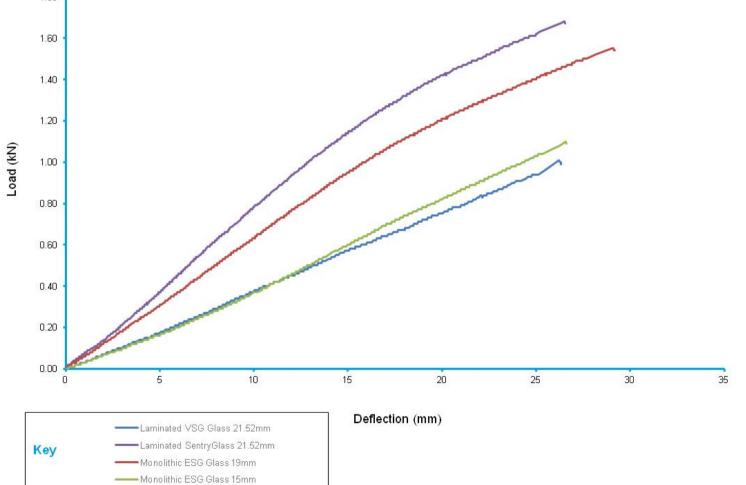



Plate 1: Generic Test Arrangement


Test Report: 143646/Ref. 4/CR1





Chart 1: Load Versus Deflection Curves for Q-railing Easy Glass Pro -F Top Mount Fixed Loaded at 1200 mm



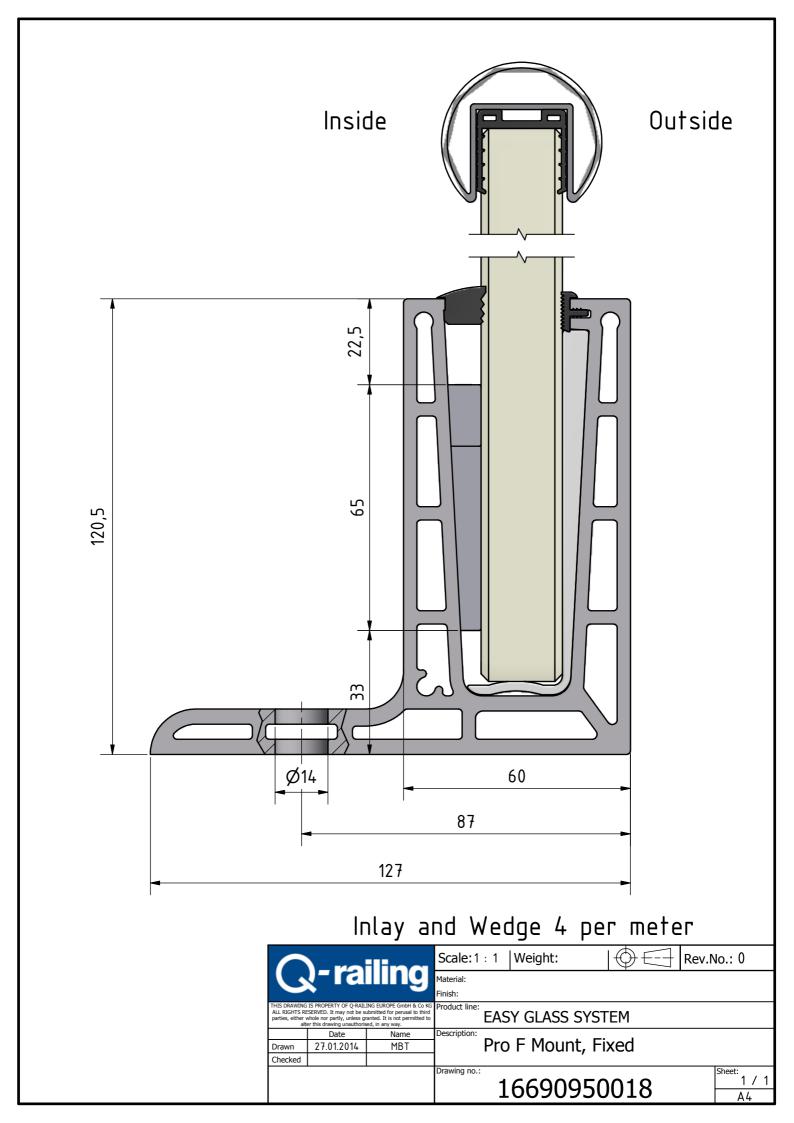

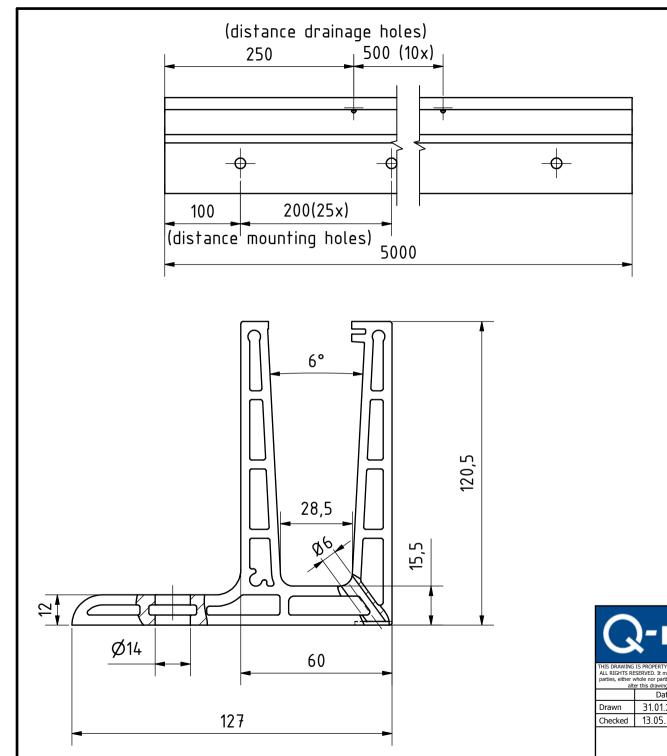

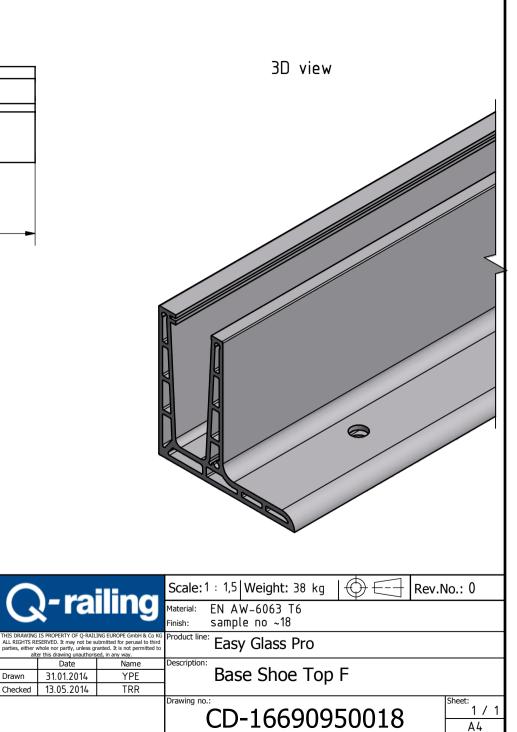

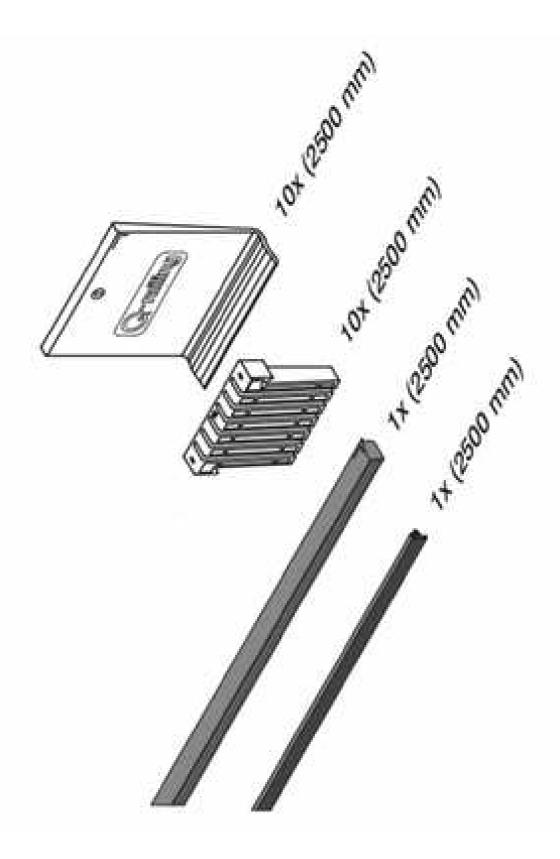



### **TEST REPORT**

Lucideon Reference:	143646 (QT-31643/1/SL)/Ref. 1
Project Title:	Testing of Q-railing Europe Glass Balustrade System to BS 6180:2011 - Easy Glass Pro-F Top Mount Adjustable
Client:	Q-railing Europe GmbH & Co.KG Marie-Curie-Strasse 8-14 Emmerich am Rhein D-46446 Germany
For the Attention of:	Mr Samuel Hanna
Author(s):	Miss Lisa Cobden
Report Date:	29 August, 2014
Purchase Order No.:	N/A
Work Location:	Lucideon UK

Mr Dave Dix Consultancy Team Reviewer

bu Con-

Miss Lisa Cobden Consultancy Team Project Manager

#### Page 1 of 8 Pages T +44 (0)1782 764428

enquiries@lucideon.com

Reg. England 1960455

www.lucideon.com

This report is issued in accordance with the Conditions of Business of Lucideon Limited and relates only to the sample(s) tester. No responsibility is taken for the accuracy of the sampling unless this is done under our own supervision. This report shall not be reproduced in part without the written approval of Lucideon Limited, nor used in any way as to lead to misrepresentation of the results or their implications.

Lucideon Ltd
 Queens Road, Penkhull
 Stoke-on-Trent
 Staffordshire ST4 7LQ, UK

Lucideon is the trading name of Lucideon Limited. Registered in England No. 1960455. Registered Office as above.

Test Report: 143646/Ref. 1

#### CONTENTS

Pa	age
1 INTRODUCTION 3	
2 TEST SAMPLES 3	
3 TEST PROGRAMME 3	
4 TEST METHOD 3	
5 RESULTS 4	
TABLES 5-6	6
PLATE 7	
CHART 8	
APPENDIX: Figures	

LSC/LMP/N14TRE46 29.08.14

#### **1 INTRODUCTION**

Lucideon were commissioned by the client, Q-railing Europe GmbH and Co KG, to carry out load testing in accordance with BS 6180:2011 Barriers in and about buildings, to allow their balustrade system to be classified for use in accordance with the Code of Practice included within the standard.

The testing was carried out at Q-railing Europe GmbH and Co KG's facilities at 8-14 Marie-Curie Straße 46446 Emmerich am Rhein Germany.

This report summarises the test results obtained during the test programme and does not provide interpretation of those results.

#### 2 TEST SAMPLES

The aluminium channel tested was designated as Easy Glass Pro-F Top Mount Adjustable. The system is shown in Figure 1.

The channel was installed by Q-railing personnel.

#### **3 TEST PROGRAMME**

A horizontal line load was applied to the aluminium channel with the following glass types installed:

- Laminated VSG Glass with 16.76 mm size (w x h):1000 mm x 1100 mm.
- Laminated VSG Glass with 21.52 mm size (w x h):1000 mm x 1100 mm.
- Monolithic ESG Glass 15 mm size (w x h): 1000 mm x 1100 mm.
- Monolithic ESG Glass 19 mm size (w x h): 1000 mm x 1100 mm.

#### 4 TEST METHOD

The channel was bolted to the top of a concrete block, which was fixed to the floor of the test facility. The 1.0 m length of channel was bolted to the block at 200 mm centres by the client using the appropriate fixings (see Figure 2).

The appropriate thickness glass panel was fitted into the channel using the 'Adjustable Wedges' at four wedges per metre top and bottom (See Figures 1 and 3)

A horizontal imposed line load was applied to the glass at a height of 1.1 m above the datum level of the floor and the deflection measured at the top central point of the panel 1.1 m above the datum level of the floor. The load was applied via a hydraulic ram and the deflection measured using a linear voltage displacement transducer (see Plate 1).

#### 5 RESULTS

The test was carried out in accordance with the guidance given in BS 6180 Barriers in and about buildings – Code of Practice. The standard states that the maximum allowable deflection for a free standing glass protective barrier panel is 25 mm.

Table 2 of BS 6180 Barriers in and about buildings – Code of Practice categorises parapets, barriers and balustrades for areas of use depending on the loads they have achieved under testing.

The loads achieved by the Q-railing Europe GmbH and Co KG glazing system tested under horizontal imposed line load to the maximum deflection of 25 mm are given in Table 1.

All figures quoted in Table 1 contain no safety factors and are direct loads as achieved by the system under test conditions.

Table 2 summarises the suitability of the tested systems in accordance with Table 2 of BS 6180:2011.

NOTE: The results given in this report apply only to the samples that have been tested.

#### END OF REPORT



Table 1:	Summary of Performance of Q-railing Europe GmbH and Co. KG Balustrade System
	Tested under Horizontal Imposed Line Load

Base Rail	Glass	Imposed Line Load at 25 mm Deflection (kN/m)	Working Line Load for System (kN/m)	Deflection at Working Line Load for System (mm)
System	Laminated VSG Glass 16.76 mm	0.55	0.36	16.37
	Laminated VSG Glass 21.52 mm	0.89	0.74	21.02
	Monolithic ESG 19 mm	1.17	0.74	14.40
	Monolithic ESG 15 mm	0.88	0.74	21.06

Table 2:	Summary of Suitability of Q-railing Europe Systems in Accordance with Table 2 of
	BS 6180:2011

Type of		Horizontal Uniformly	Easy Glass	Easy Glass Pro-F Top Mount Adjustable			
Occupancy for Part of the Building	Occupancy for Part of the Examples of Specific Use		16.76 mm	21.52 mm	19 mm	15 mm	
Domestic and	(i) all areas within or serving exclusively one single family dwelling including stairs, landings, etc but excluding external balconies and edges of roofs	0.36	✓	✓	V	✓	
residential activities	(ii) other residential, i.e. houses of multiple occupancy and balconies, including Juliette balconies and edges of roofs in single family dwellings	0.74	х	✓	V	✓	
	(iii) light access stairs and gangways not more than 600 mm wide	0.22	~	~	~	✓	
Offices and work areas not included	(iv) light pedestrian traffic routes in industrial and storage buildings except designated escape routes	0.36	~	~	~	~	
elsewhere, including storage areas	(v) areas not susceptible to overcrowding in office and institutional buildings, also industrial and storage buildings except as given above	0.74	Х	~	V	~	
Areas where people might congregate	(vi) areas having fixed seating within 530 mm of the barrier, balustrade or parapet	1.50	х	х	х	х	

Test Report: 143646/Ref. 1

Type of		Horizontal			s Pro-F Top Mount Adjustable		
Occupancy for Part of the Building	Examples of Specific Use	Uniformly Distributed Line Load (kN/m)	16.76 mm	21.52 mm	19 mm	15 mm	
Areas with tables or fixed seating	(vii) restaurants and bars	1.50	х	х	х	Х	
Areas without	(viii) stairs, landings corridors ramps	0.74	х	~	~	$\checkmark$	
obstacles for moving people and not susceptible to overcrowding	(ix) external balconies including Juliette balconies and edges of roofs; footways and pavements within building cartilage adjacent to basement/sunken areas	0.74	х	¥	V	V	
	(x) footways or pavements less than 3 m wide adjacent to sunken areas	1.50	х	х	х	х	
Areas susceptible to overcrowding	(xi) theatres, cinemas, discotheques, bars, auditoria, shopping malls, assembly areas, studios; footways or pavements greater than 3 m wide adjacent to sunken areas	3.00	х	х	х	х	
	(xii) grandstands and stadia	(Note 1)	-	-	-	-	
Retail areas	(xiii) all retail areas including public areas of banks/building societies or betting shops	1.50	х	х	х	х	
Vehicular	(xiv) pedestrian areas in car parks, including stairs, landings, ramps, edges of internal floors, footways, edges of roofs	1.50 (Note 2)	Х	Х	x	х	
	(xv) horizontal loads imposed by vehicles	(Note 2)	-	-	-	-	

Note 1 – See requirements of the appropriate certifying authority Note 2 – Clause 8.1.1 of BS 6180:2011 states that "glass should not be used for vehicle protection barriers"

Test Report: 143646/Ref. 1



Plate 1: Generic Test Arrangement





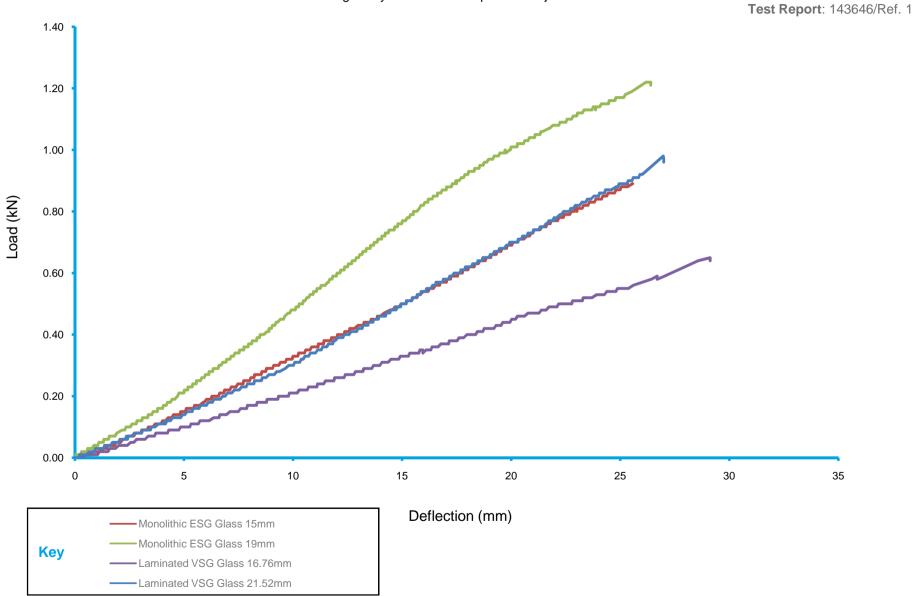


Chart 1: Load Versus Defelction Curves for Q-railing Easy Glass Pro F TopMount Adjustable

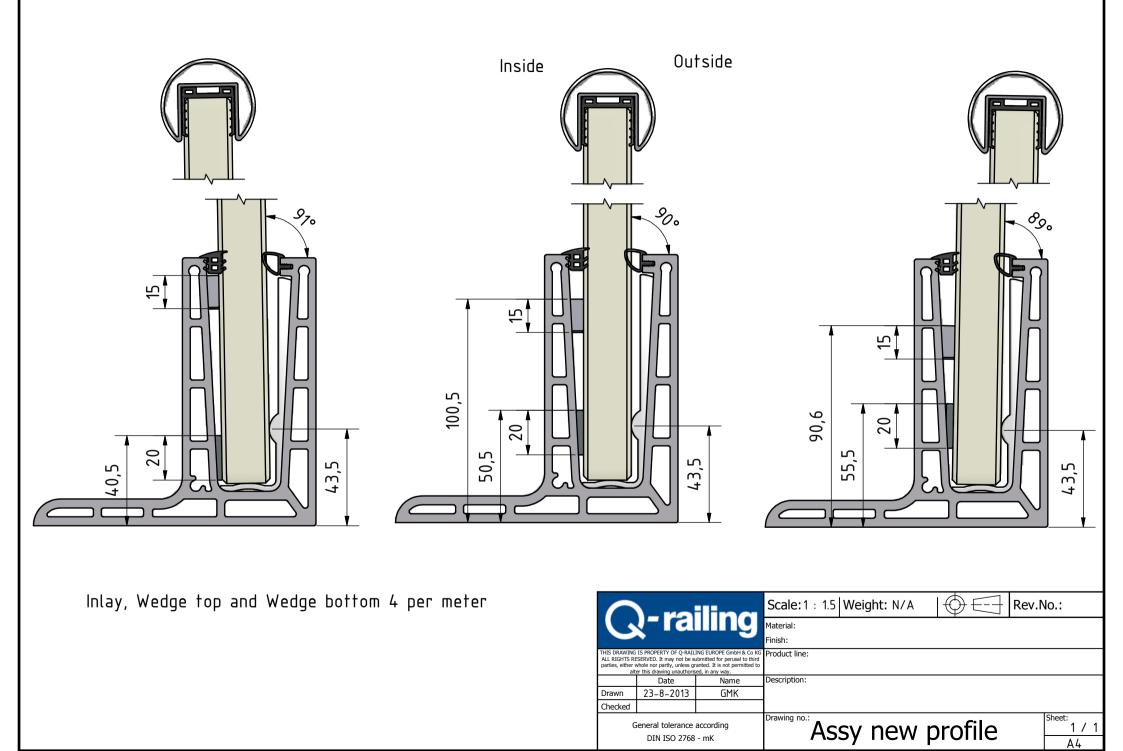

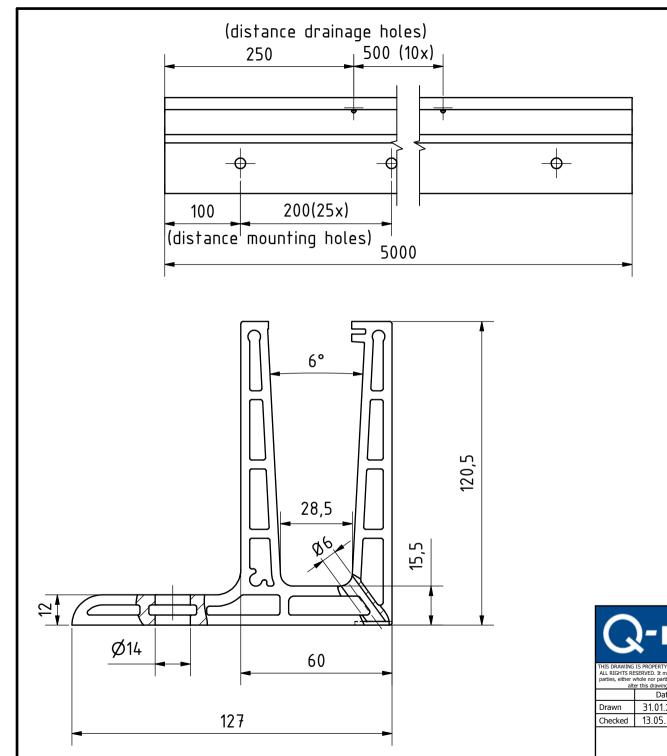

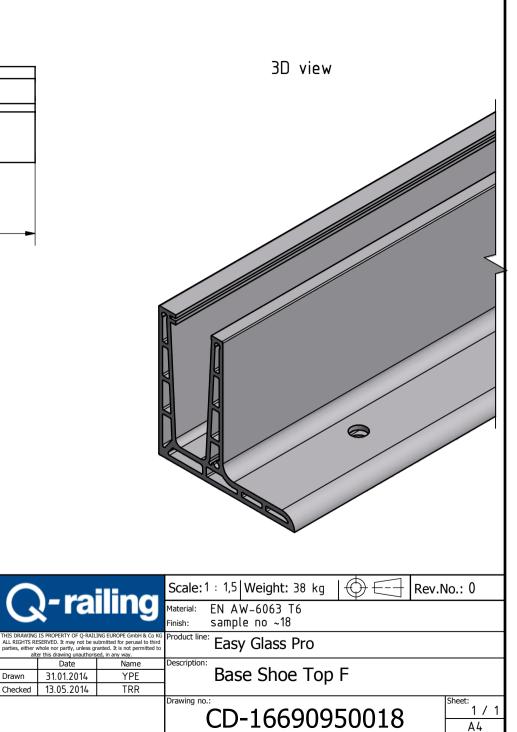

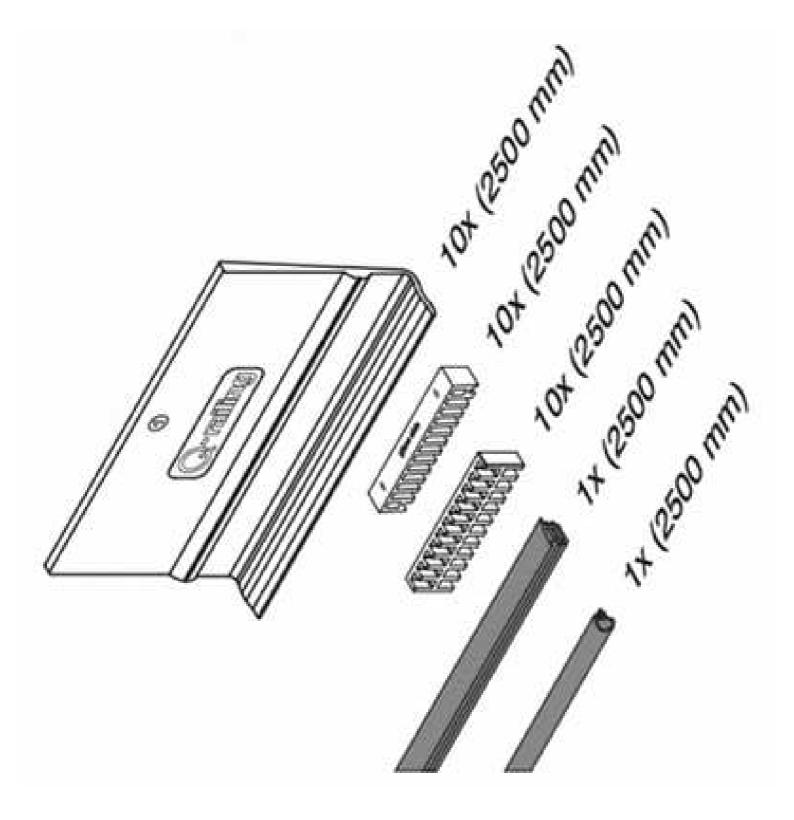



### **TEST REPORT**

Lucideon Reference:	143646 (QT-31643/1/SL)/Ref. 2
Project Title:	Testing of Q-railing Europe Glass Balustrade System to BS 6180:2011 - Easy Glass Pro-F Top Mount Adjustable 1200 mm Horizontal Line Load
Client:	Q-railing Europe GmbH & Co.KG Marie-Curie-Strasse 8-14 Emmerich am Rhein D-46446 Germany
For the Attention of:	Mr Samuel Hanna
Author(s):	Miss Lisa Cobden
Report Date:	29 August, 2014
Purchase Order No.:	N/A
Work Location:	Lucideon UK

Mr Dave Dix Consultancy Team Reviewer

bu Coll-

Miss Lisa Cobden Consultancy Team Project Manager

#### Page 1 of 8 Pages

This report is issued in accordance with the Conditions of Business of Lucideon Limited and relates only to the sample(s) tester. No responsibility is taken for the accuracy of the sampling unless this is done under our own supervision. This report shall not be reproduced in part without the written approval of Lucideon Limited, nor used in any way as to lead to misrepresentation of the results or their implications.

Lucideon Ltd
 Queens Road, Penkhull
 Stoke-on-Trent
 Staffordshire ST4 7LQ, UK

T +44 (0)1782 764428 enquiries@lucideon.com www.lucideon.com Reg. England 1960455

Lucideon is the trading name of Lucideon Limited. Registered in England No. 1960455. Registered Office as above.

Test Report: 143646/Ref. 2

#### CONTENTS

Pa	age
1 INTRODUCTION 3	
2 TEST SAMPLES 3	
3 TEST PROGRAMME 3	
4 TEST METHOD 3	
5 RESULTS 4	
TABLES 5-6	6
PLATE 7	
CHART 8	
APPENDIX: Figures	

LSC/LMP/N14TRE47 29.08.14

#### **1 INTRODUCTION**

Lucideon were commissioned by the client, Q-railing Europe GmbH and Co KG, to carry out load testing based on that detailed in BS 6180:2011 Barriers in and about buildings. This was to allow their balustrade system to be classified for use in accordance with the Code of Practice included within the standard. The test method deviated from the standard such that the horizontal imposed line load was applied to the glass at a height of 1.2 m above the datum level of the floor in comparison to 1.1 m stated in the standard. Deflection of the glass panel was measured at the top central point and was also recorded at 1.2 m above the datum level of the floor.

The testing was carried out at Q-railing Europe GmbH and Co KG's facilities at 8-14 Marie-Curie Straße 46446 Emmerich am Rhein Germany.

This report summarises the test results obtained during the test programme and does not provide interpretation of those results.

#### 2 TEST SAMPLES

The aluminium channel tested was designated as Easy Glass Pro-F Top Mount Adjustable. The system is shown in Figure 1.

The channel was installed by Q-railing personnel.

#### **3 TEST PROGRAMME**

A horizontal line load was applied to the aluminium channel with the following glass types installed:

- Laminated VSG Glass 21.52 mm size (w x h):1000 mm x 1200 mm.
- Monolithic ESG Glass 19 mm size (w x h): 1000 mm x 1200 mm.
- Monolithic ESG Glass 15 mm size (w x h): 1000 mm x 1200 mm.

#### 4 TEST METHOD

The channel was bolted to the top of a concrete block, which was fixed to the floor of the test facility. The 1.0 m length of channel was bolted to the block at 200 mm centres by the client using the appropriate fixings (see Figure 2).

The appropriate thickness glass panel was fitted into the channel using the 'Adjustable Wedges' at four wedges per metre top and bottom (see Figures 1 and 3).

A horizontal imposed line load was applied to the glass at a height of 1.2 m above the datum level of the floor and the deflection measured at the top central point of the panel 1.2 m above the datum level of the floor. The load was applied via a hydraulic ram and the deflection measured using a linear voltage displacement transducer (see Plate 1).

#### 5 RESULTS

The test was carried out in accordance with the guidance given in BS 6180 Barriers in and about buildings – Code of Practice. The standard states that the maximum allowable deflection for a free standing glass protective barrier panel is 25 mm.

Table 2 of BS 6180 Barriers in and about buildings – Code of Practice categorises parapets, barriers and balustrades for areas of use depending on the loads they have achieved under testing.

The loads achieved by the Q-railing Europe GmbH and Co KG glazing system tested under horizontal imposed line load to the maximum deflection of 25 mm are given in Table 1.

All figures quoted in Table 1 contain no safety factors and are direct loads as achieved by the system under test conditions.

Table 2 summarises the suitability of the tested systems in accordance with Table 2 of BS 6180:2011.

NOTE: The results given in this report apply only to the samples that have been tested.

#### END OF REPORT



Table 1:	Summary of Performance of Q-railing Europe GmbH and Co KG Balustrade System Tested
	under Horizontal Imposed Line Load

Base Rail	Glass	Imposed Line Load at 25 mm Deflection (kN/m)	Working Line Load for System (kN/m)	Deflection at Working Line Load for System (mm)
	Laminated VSG Glass 21.52 mm	0.65	0.36	14.73
	Monolithic ESG 19 mm	0.90	0.74	21.27
	Monolithic ESG 15 mm	0.52	0.36	19.06

### Table 2:Summary of Suitability of Q-railing Europe Systems in Accordance with Table 2 of<br/>BS 6180:2011

Type of Occupancy for	Examples of Specific Use	Horizontal Uniformly Distributed Line Load (kN/m)	Easy Glass Pro-F Top Mount Adjustable		
Part of the Building			21.52 mm	19 mm	15 mm
Domestic and residential activities	(i) all areas within or serving exclusively one single family dwelling including stairs, landings, etc but excluding external balconies and edges of roofs	0.36	¥	¥	~
	(ii) other residential, i.e. houses of multiple occupancy and balconies, including Juliette balconies and edges of roofs in single family dwellings	0.74	х	~	x
Offices and work areas not included elsewhere, including storage areas	(iii) light access stairs and gangways not more than 600 mm wide	0.22	~	~	~
	(iv) light pedestrian traffic routes in industrial and storage buildings except designated escape routes	0.36	✓	~	~
	(v) areas not susceptible to overcrowding in office and institutional buildings, also industrial and storage buildings except as given above	0.74	х	V	x
Areas where people might congregate	(vi) areas having fixed seating within 530 mm of the barrier, balustrade or parapet	1.50	х	х	х
Areas with tables or fixed seating	(vii) restaurants and bars	1.50	Х	Х	Х

Test Report: 143646/Ref. 2

Type of Occupancy for	Examples of Specific Use	Horizontal Uniformly	Easy Glass Pro-F Top Mount Adjustable		
Areas without obstacles for moving people and not susceptible to overcrowding	(viii) stairs, landings corridors ramps	0.74	Х	~	Х
	(ix) external balconies including Juliette balconies and edges of roofs; footways and pavements within building cartilage adjacent to basement/sunken areas	0.74	Х	V	х
Areas susceptible to overcrowding	<ul> <li>(x) footways or pavements</li> <li>less than 3 m wide adjacent</li> <li>to sunken areas</li> </ul>	1.50	Х	x	x
	(xi) theatres, cinemas, discotheques, bars, auditoria, shopping malls, assembly areas, studios; footways or pavements greater than 3 m wide adjacent to sunken areas	3.00	х	x	x
	(xii) grandstands and stadia	(Note 1)	-	-	-
Retail areas	(xiii) all retail areas including public areas of banks/building societies or betting shops	1.50	х	x	x
Vehicular	(xiv) pedestrian areas in car parks, including stairs, landings, ramps, edges of internal floors, footways, edges of roofs	1.50 (Note 2)	Х	x	x
	(xv) horizontal loads imposed by vehicles	(Note 2)	-	-	-

Note 1 – See requirements of the appropriate certifying authority Note 2 – Clause 8.1.1 of BS 6180:2011 states that "glass should not be used for vehicle protection barriers"

Test Report: 143646/Ref. 2



Plate 1: Generic Test Arrangement





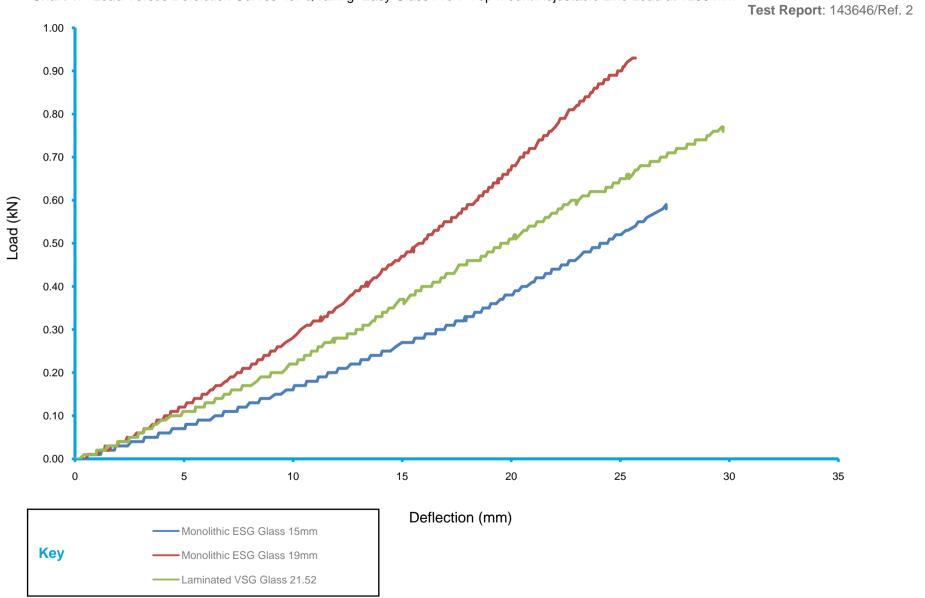


Chart 1: Load Versus Defelction Curves for Q-railing Easy Glass Pro-F Top Mount Adjustable Line Load at 1200 mm

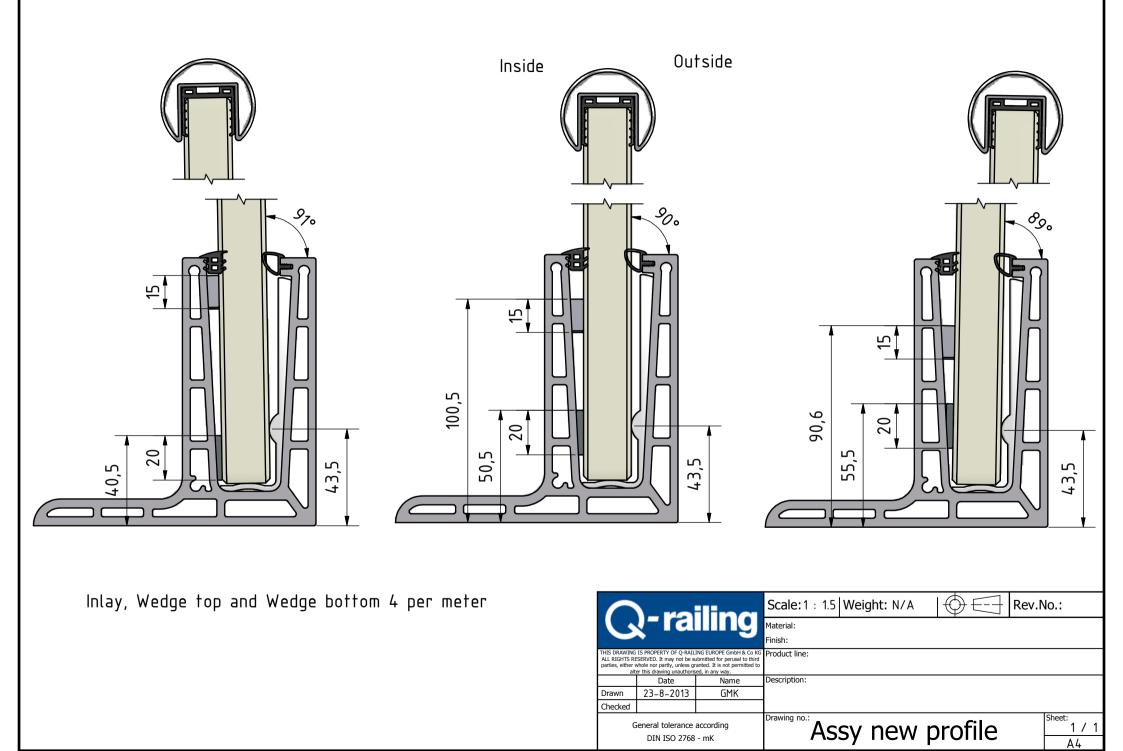

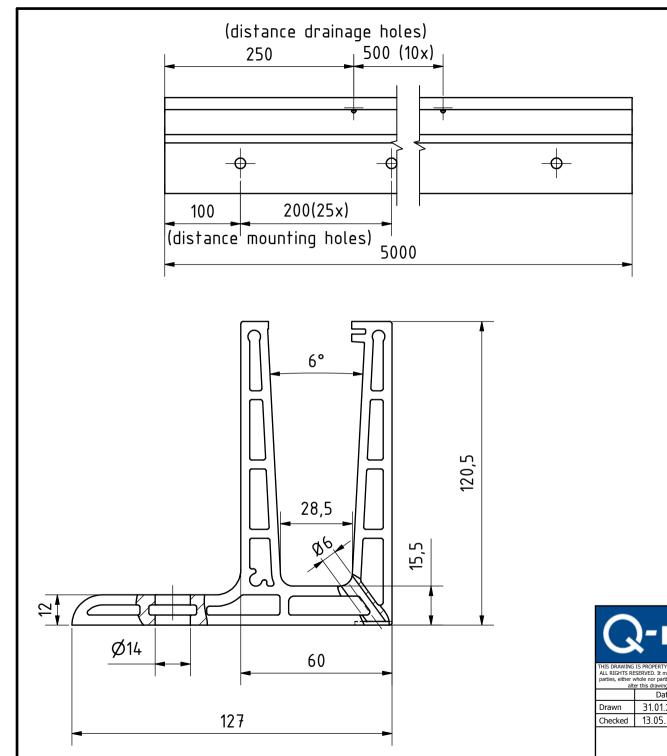

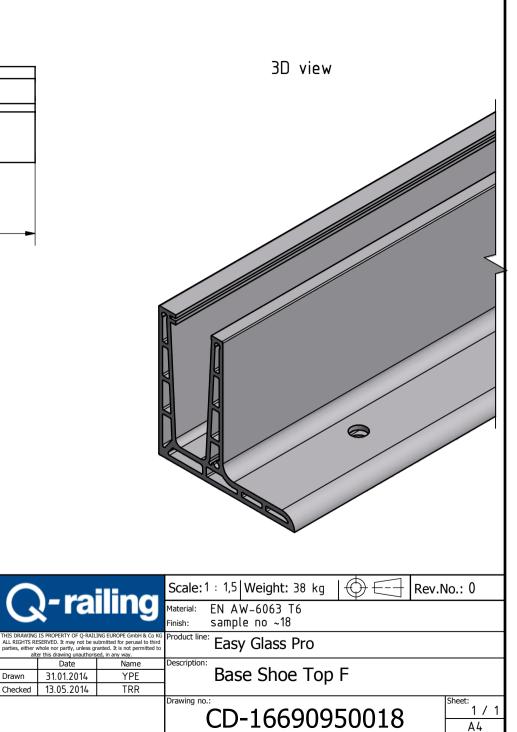

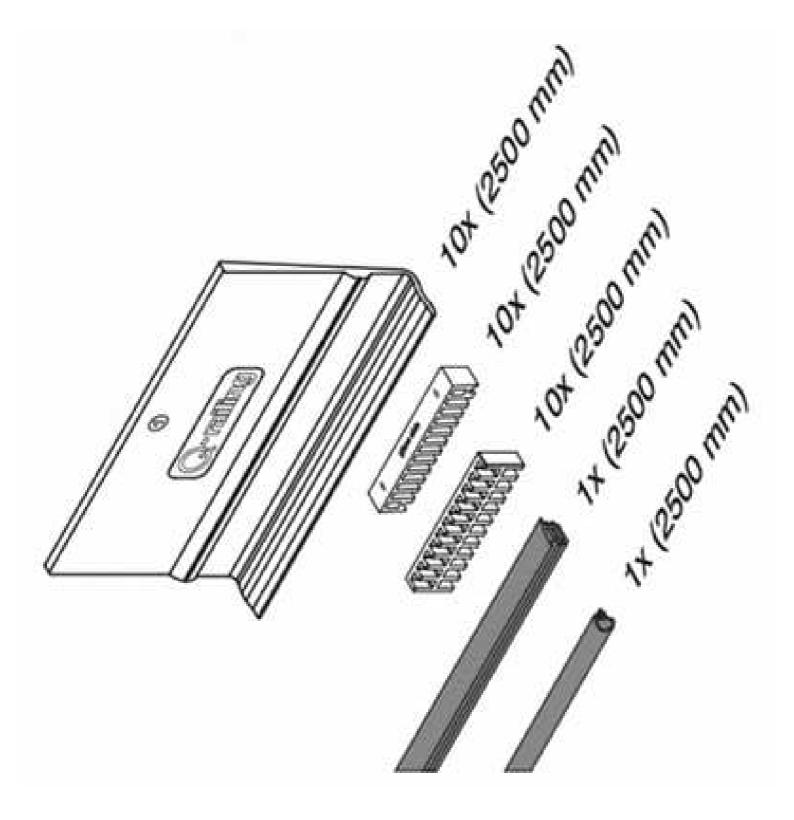

### GOOD LUCK WITH YOUR INSTALLATION!

VIEL ERFOLG MIT IHRER MONTAGE!

SUCCES MET DE INSTALLATIE!

Q-railing